

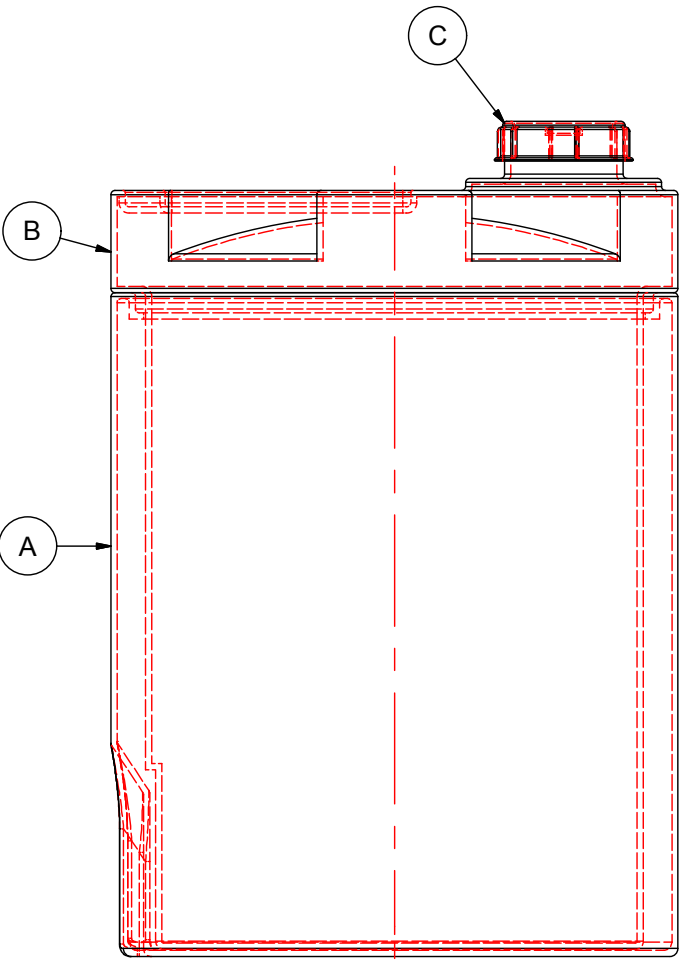


- NOTES:
- 1. TANK IS MANUFACTURED TO ASTM-D-1998 STANDARD.
 - 2. ALL DIMENSIONS ARE APPROXIMATE.
 - 3. BOTTOM OUTLET MAY ONLY BE LOCATED ON FITTING FLAT AT 180°.

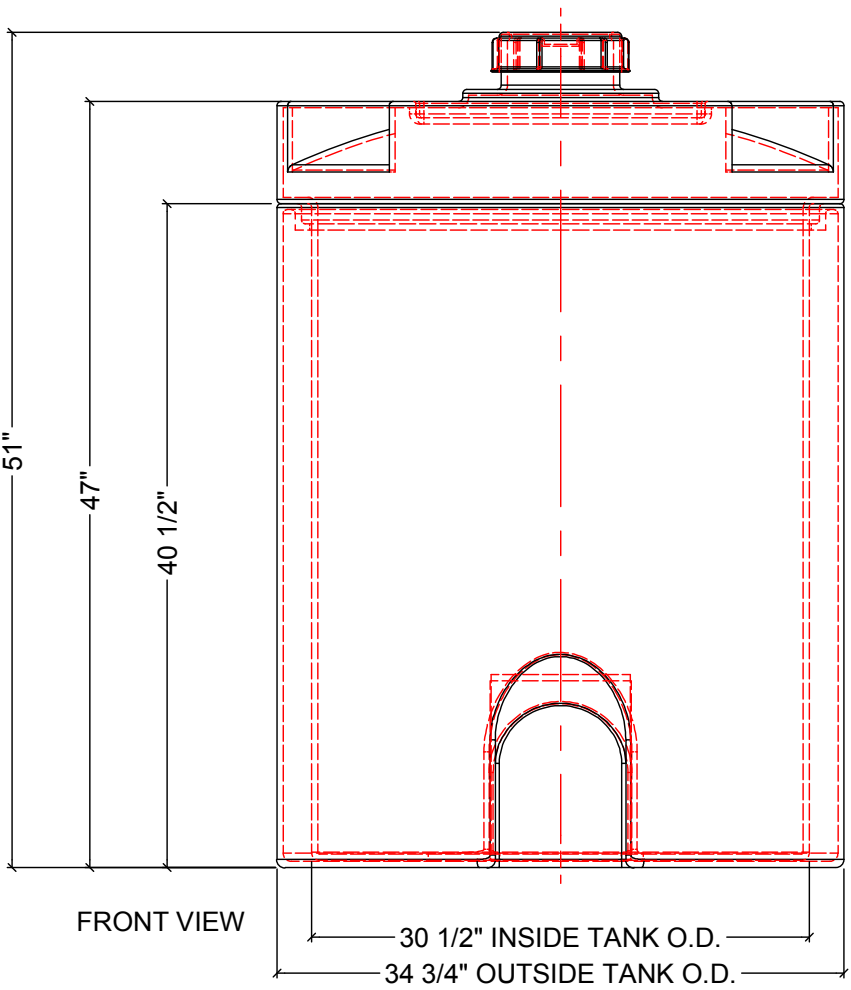

MATERIALS LIST		
ITEMS	DESCRIPTION	NOTES
A	DMT-100-OUTSIDE TANK	
B	DMT-100-INSIDE TANK	
C	6" THREADED LID	

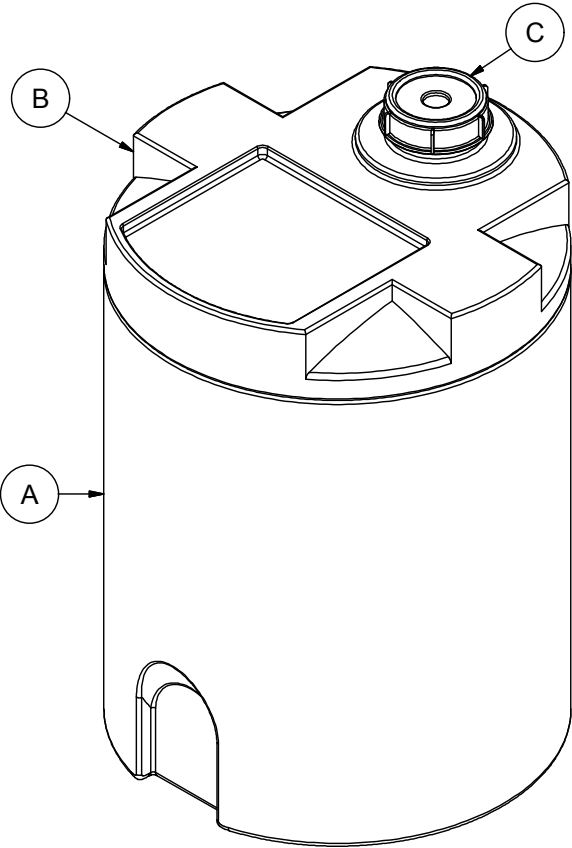

REV	DATE	DESCRIPTION	BY	APPD	REVD
REVISIONS					
CUSTOMER					
TITLE		ACO JOB NO:			
100 IG DOUBLE WALL TANK		PURCHASE ORDER NO:			
		PURCHASER'S EQUIP. NO:			
THIS DRAWING IS THE PROPERTY OF ROTOPLAST INC. AND SHALL NOT BE COPIED OR TRANSFERRED WITHOUT THE WRITTEN CONSENT OF ROTOPLAST INC.					
ENGINEERS SEAL		ACO CONTAINER SYSTEMS DIVISION OF ROTOPLAST INC.			
		PICKERING - ONTARIO - CANADA			
ACO CONTAINER SYSTEMS DIVISION OF ROTOPLAST INC. 794 MCKAY RD. PICKERING, ONTARIO, CANADA TEL. 905-683-8222 FAX 905-683-2969		DESIGNED			
		DRAWN	WM		
		CHECKED			
		APPROVED			
		SCALE	N.T.S.		
		DATE	28-03-16		
DWG No		DMT-100			REV 0